


TESTED BY _____ DATE _____

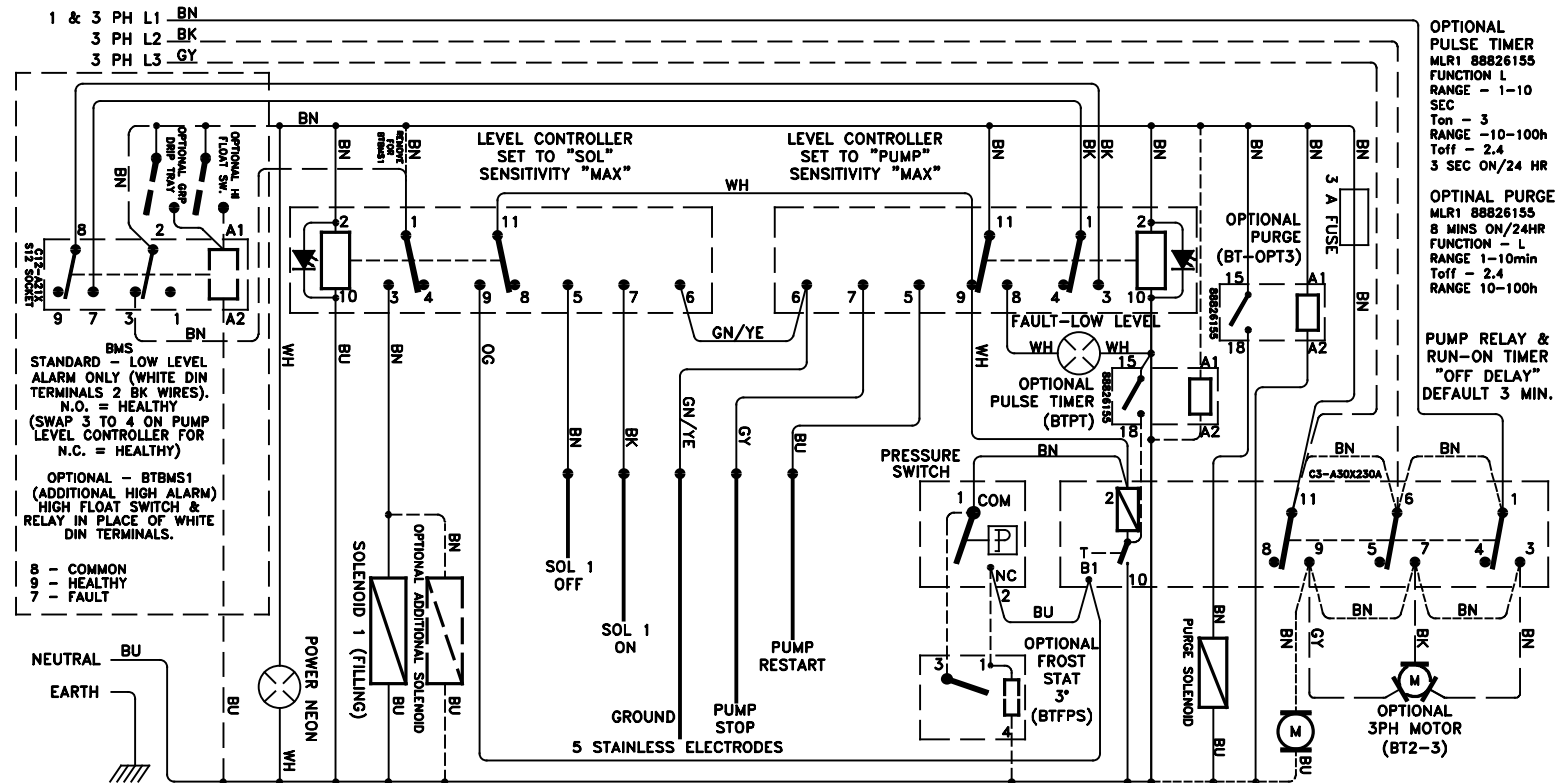

OPTIONAL
PULSE TIMER
MLR1 88826155
FUNCTION L
RANGE - 1-10
SEC
Ton - 3
RANGE -10-100h
Toff - 2.4
3 SEC ON/24 HR

OPTIONAL PURGE
MLR1 88826155
8 MINS ON/24HR
FUNCTION - L
RANGE 1-10min
Toff - 2.4
RANGE 10-100h

PUMP RELAY &
RUN-ON TIMER
"OFF DELAY"
DEFAULT 3 MIN.

OPERATION

CISTERN FILLING IS VIA NORMALLY CLOSED SOLENOID VALVE CONTROLLED BY "SOL 1" LEVEL CONTROLLER. THE RELAY ENERGISED LED ILLUMINATES WHEN THE SOLENOID IS POWERED. THE SOLENOID OPENS ONCE THE WATER HAS DROPPED BELOW THE "SOL 1 ON" ELECTRODE AND CLOSSES ONCE THE "SOL 1 OFF" ELECTRODE IS SUBMERGED.

THE PUMP IS CONTROLLED BY A PRESSURE SWITCH, RUN-ON TIMER AND LOW LEVEL "PUMP" CONTROLLER. THE "PUMP" CONTROLLER CUTS POWER TO THE PUMP WHEN THE CISTERN IS ALMOST EMPTY. THE LED ILLUMINATES WHEN THE "PUMP STOP" ELECTRODE IS EXPOSED - THE PUMP RESTARTS ONCE THE "PUMP RESTART" ELECTRODE IS SUBMERGED. ONCE THE PRESSURE VESSEL IS RECHARGED, THE PRESSURE SWITCH OPENS AND THE RUN-ON TIMER CONTINUES POWERING THE PUMP FOR THE SELECTED PERIOD - NORMALLY 3 MINUTES. ANY DRAW-OFF CAUSING THE FILLING SOLENOID TO OPERATE, RESETS THE RUN-ON PERIOD.

OPTIONAL - PULSE TIMER, OPERATES THE PUMP FOR 1 SEC EVERY 24 HOURS TO AVOID PUMP SEIZURE / PURGE OPTION / HIGH ALARM FLOAT SWITCH / FROST STAT RUNS PUMP / OPTIONAL GRP DRIP TRAY WITH FLOAT SWITCH.
GO TO arrowvalves.co.uk FOR FAULT FINDING CHART.

T. 01442 823123
arrowvalves.co.uk
AM009V 10/08/20

ARROW VALVES LTD
YORK HOUSE
NORTHBRIDGE ROAD
BERKHAMSTED
HERTS HP4 1TA
email: technical@arrowvalves.co.uk
web: www.arrowvalves.co.uk

Arrow
Valves

TITLE:

BT WIRING DIAGRAM FIXED SPEED

DRN:

RM

CHECKED BY:

DATE:

© 2020

This drawing is the property of Arrow Valves Ltd and must not be copied without prior written permission

MATERIAL: CARD 160 g/sqm

FINISH: LAMINATED

SCALE: 100%

DRG No: AM009W DATE: 10/08/20